


## Use Low-Grade Waste Steam to Power Absorption Chillers

Absorption chillers use heat, instead of mechanical energy, to provide cooling. The mechanical vapor compressor is replaced by a thermal compressor (see figure) that consists of an absorber, a generator, a pump, and a throttling device. The refrigerant vapor from the evaporator is absorbed by a solution mixture in the absorber. This solution is then pumped to the generator where the refrigerant is revaporized using a waste steam heat source. The refrigerant-depleted solution is then returned to the absorber via a throttling device. The two most common refrigerant/absorbent mixtures used in absorption chillers are water/lithium bromide and ammonia/water.

Comparison of Mechanical and Thermal Vapor Compression Systems\*

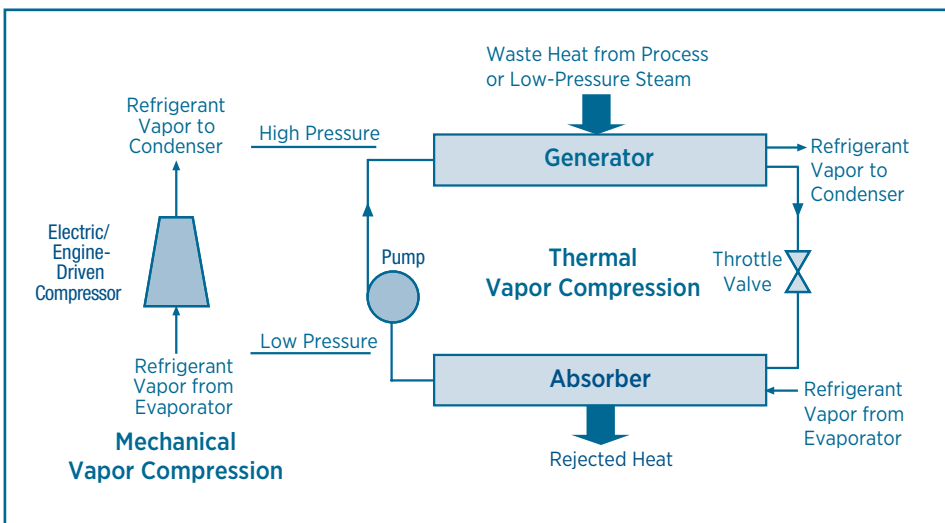

\*The evaporator and the condenser, required for both systems, are not shown in the figure.

Compared to mechanical chillers, absorption chillers have a low coefficient of performance ( $COP = \text{chiller load/heat input}$ ). Nonetheless, they can substantially reduce operating costs because they are energized by low-grade waste heat, while vapor compression chillers must be motor- or engine-driven.

Low-pressure, steam-driven absorption chillers are available in capacities ranging from 100 to 1,500 tons. Absorption chillers come in two commercially available designs: single-effect and double-effect. Single-effect machines provide a thermal COP of 0.7 and require about 18 pounds of 15-pounds-per-square-inch-gauge (psig) steam per ton-hour of cooling. Double-effect machines are about 40% more efficient, but require a higher grade of thermal input, using about 10 pounds of 100- to 150-psig steam per ton-hour.

### Suggested Actions

Determine the cost-effectiveness of displacing a portion of your cooling load with a waste-steam absorption chiller by taking the following steps:

- Conduct a plant survey to identify sources and availability of waste steam.
- Determine cooling load requirements and the cost of meeting those requirements with existing mechanical chillers or new installations.
- Obtain installed cost quotes for a waste-steam absorption chiller.
- Conduct a life-cycle cost analysis to determine if the waste-steam absorption chiller meets your company's cost-effectiveness criteria.

## Example

In a plant where low-pressure steam is currently being exhausted to the atmosphere, a mechanical chiller with a COP of 4.0 is used 4,000 hours per year (hr/yr) to produce an average of 300 tons of refrigeration. The cost of electricity at the plant is \$0.06 per kilowatt-hour (kWh).

An absorption unit requiring 5,400 pounds per hour of 15-psig steam could replace the mechanical chiller, providing annual electrical cost savings of:

$$\begin{aligned} \text{Annual Savings} &= 300 \text{ tons} \times (12,000 \text{ Btu/ton} / 4.0) \times 4,000 \text{ hr/yr} \\ &\quad \times \$0.06/\text{kWh} / 3,413 \text{ Btu} \\ &= \$63,287 \end{aligned}$$

Adapted from an Energy TIPS fact sheet that was originally published by the Industrial Energy Extension Service of Georgia Tech.

## Resources

U.S. Department of Energy—DOE's software, the *Steam System Assessment Tool and Steam System Scoping Tool*, can help you evaluate and identify steam system improvements. In addition, refer to *Improving Steam System Performance: A Sourcebook for Industry* for more information on steam system efficiency opportunities.

Visit the Advanced Manufacturing Office website at [manufacturing.energy.gov](http://manufacturing.energy.gov) to access these and many other industrial efficiency resources and information on training.

U.S. DEPARTMENT OF  
**ENERGY**

Energy Efficiency &  
Renewable Energy

The Advanced Manufacturing Office (AMO) works with diverse partners to develop and deploy technologies and best practices that will help U.S. manufacturers continually improve their energy performance and succeed in global markets. AMO's Better Plants program works with U.S. corporations through a CEO-endorsed pledge to improve energy efficiency. AMO's tools, training, resources, and recognition programs can help build energy management capacity within the industrial sector and supply chains. Use these resources to comply with requirements of the ISO 50001 standard and the Superior Energy Performance program.

With our partners, AMO leverages additional federal, state, utility, and local resources to help manufacturers save energy, reduce climate and environmental impacts, enhance workforce development, and improve national energy security and competitiveness throughout the supply chain.

Advanced Manufacturing Office  
Energy Efficiency and Renewable Energy  
U.S. Department of Energy  
Washington, DC 20585-0121  
[manufacturing.energy.gov](http://manufacturing.energy.gov)