

Saving Water and Operating Costs at NREL's HPC Data Center

Thomas P. Carter, P.E.
Johnson Controls
Thomas.P.Carter@jci.com



David Sickinger
National Renewable Energy Laboratory
David.Sickinger@nrel.gov



IDEA2017 Conference
June 28, 2017
Scottsdale, Arizona

NREL/PR-2C00-68659

4A-District Energy & Water Strategies for Sustainable Operation


Outline/Agenda

- Traditional and hybrid choices for heat rejection
- Description and operation of the thermosyphon cooler (TSC)
- Description of the National Renewable Energy Laboratory's (NREL's) Energy Systems Integration Facility (ESIF) High Performance Computing (HPC) Data Center and installation of the TSC
- Initial system modeling
- Initial results/conclusions.

Air- and Water-Cooled System Options


Air-Cooled System

- Design day is based on **DRY BULB** temperature
- Consumes no water (no evaporative cooling)
- Large footprint/requires very large airflow rates.

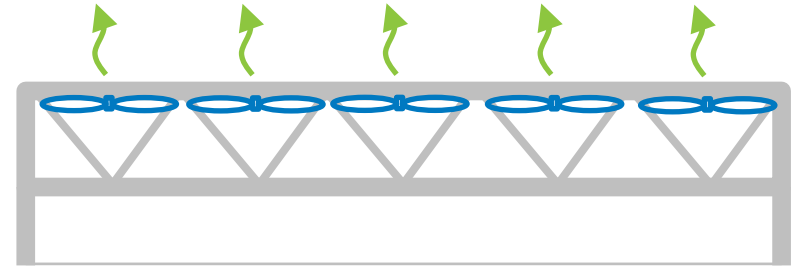

Water-Cooled System

- Design day is based on the lower **WET BULB** temperature
- Evaporative cooling process uses water to improve cooling efficiency
 - **80% LESS AIRFLOW** → lower fan energy
 - Lower cost and smaller footprint.
- Colder heat-rejection temperatures improve system efficiency.





However, water-cooled systems depend on a reliable, continuous source of low-cost water.


Weather and Load Variations: Opportunities for Hybrid Wet/Dry Solutions

Basic principles:


- Operates **wet** during peak design periods to save energy (high temperatures and loads)
- Operates **dry** during low design periods to save water (lower temperatures and loads)
- Depending on the design, system might operate either as **wet** or **dry** or might be able to operate both **wet** and **dry**.

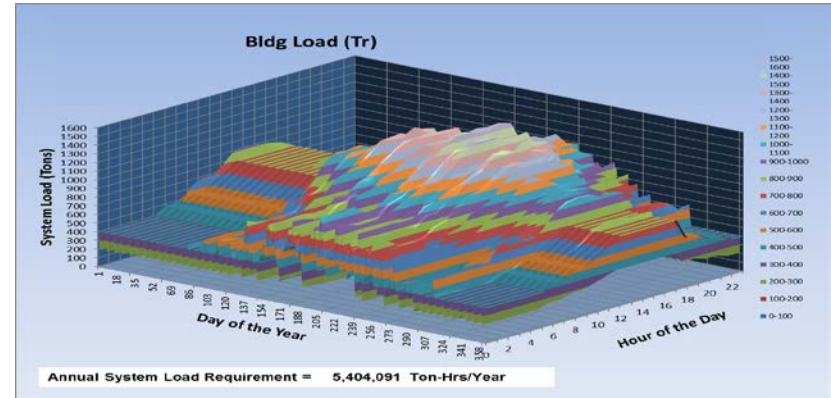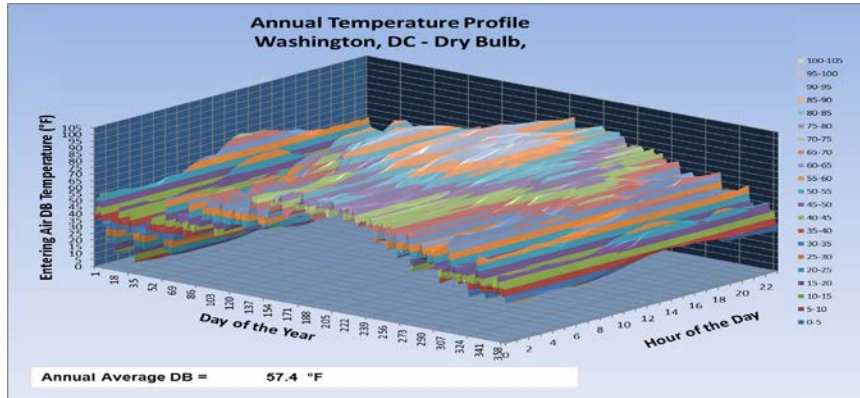

Basic Hybrid System Concept

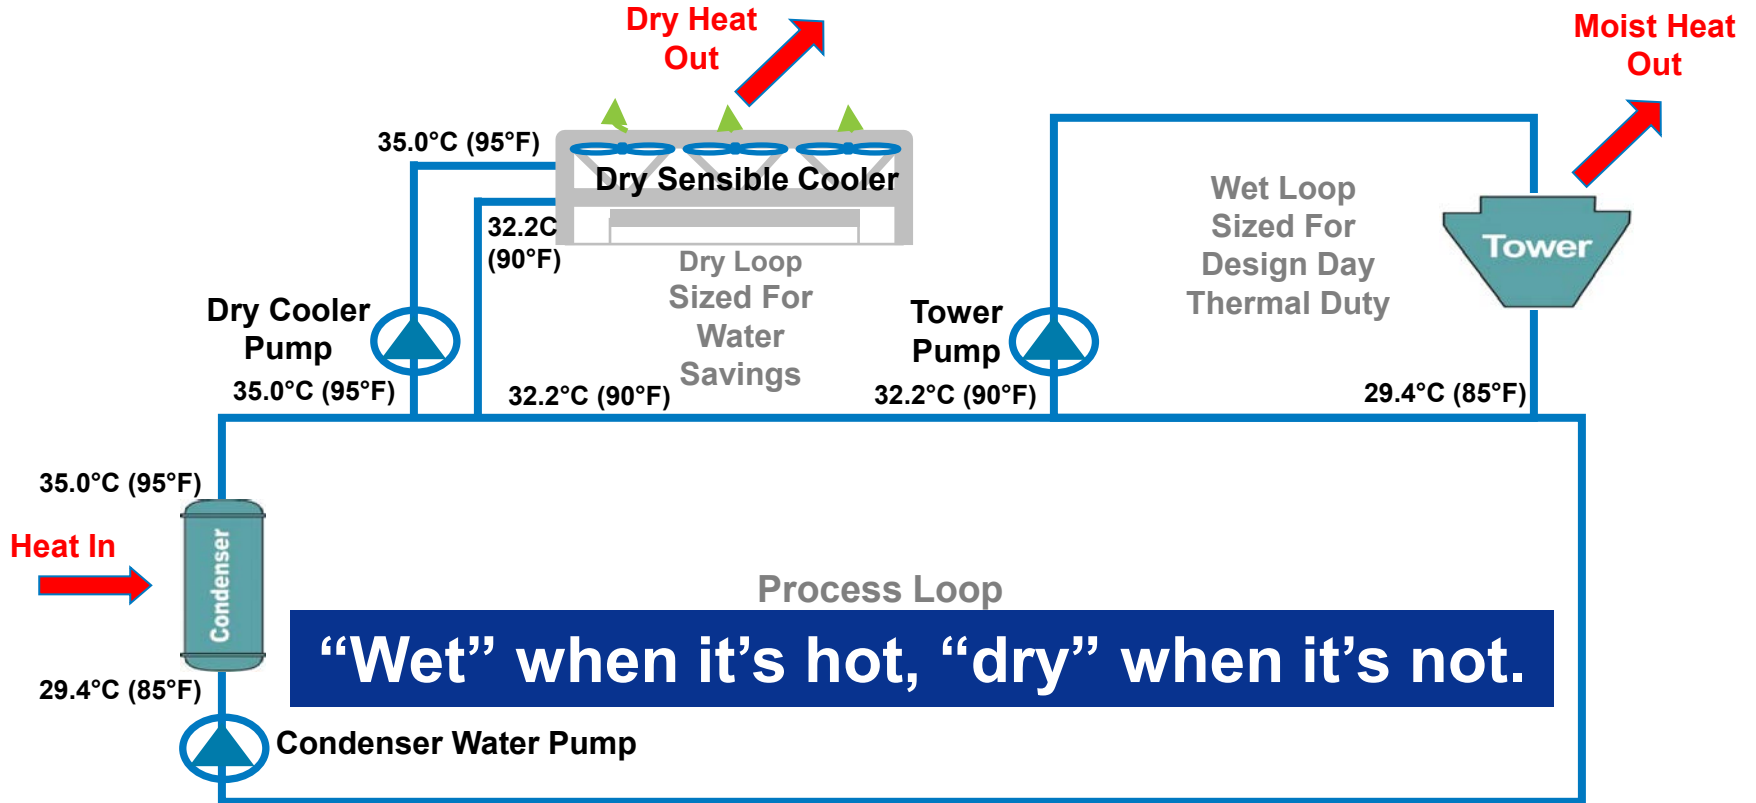

Thermosyphon Cooler

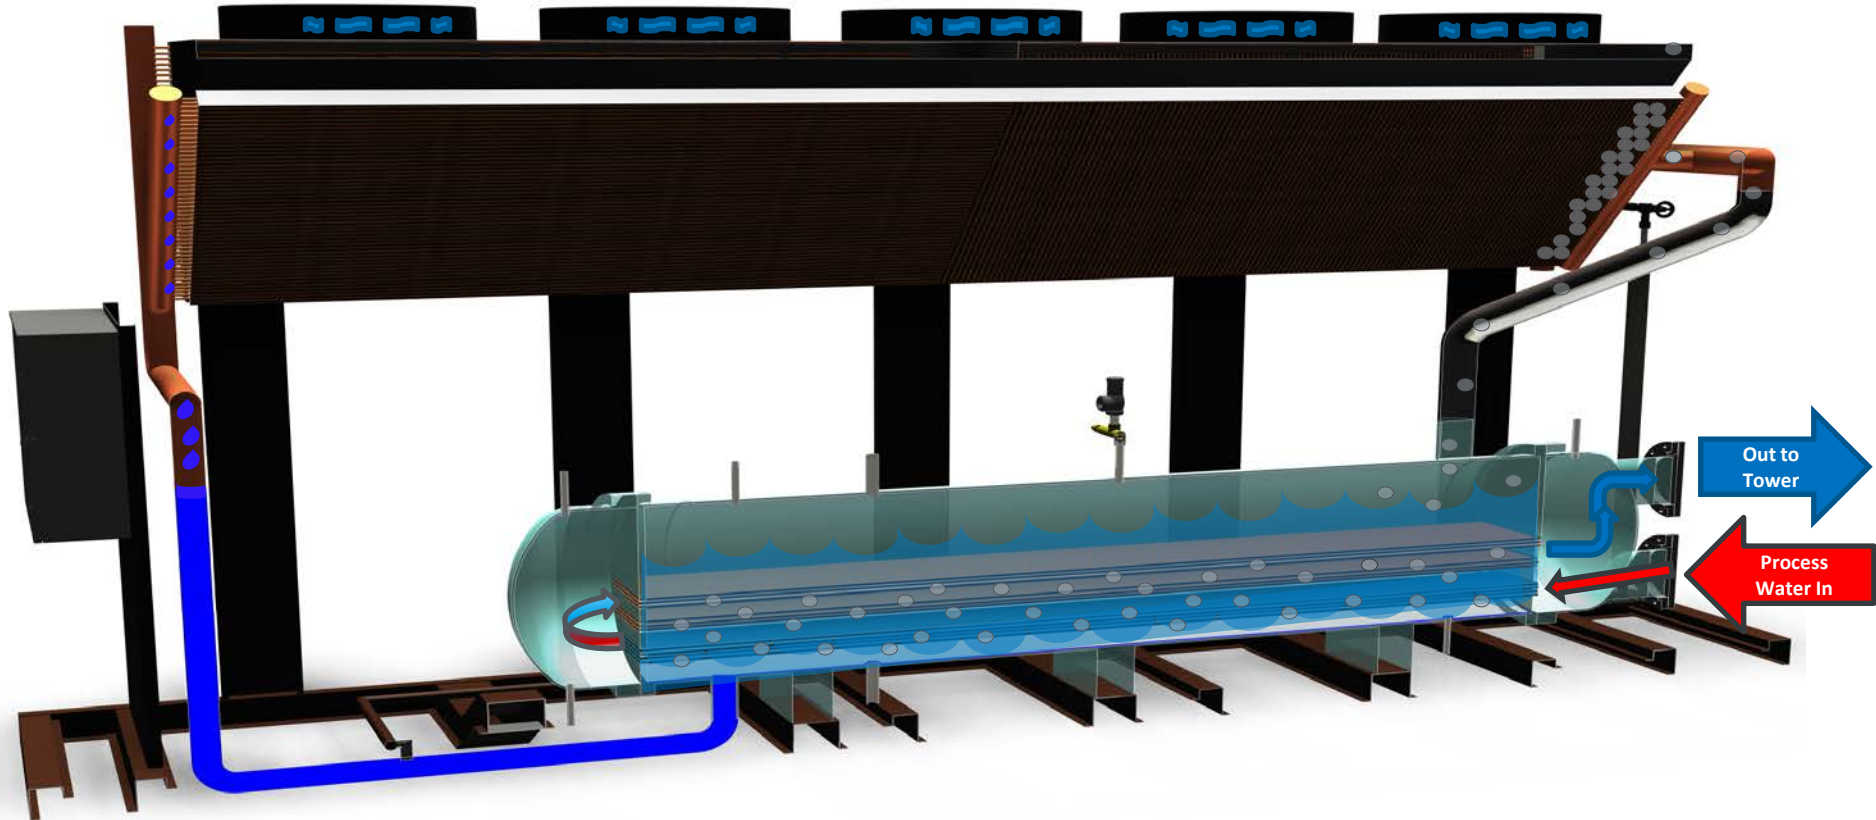

NREL Campus



ESIF HPC Data Center

- Annualized average power usage effectiveness (PUE) rating of better than 1.06 since opening in 2012
- Based on industry/tech trends, committed to direct liquid cooling at the rack
 - No mechanical chillers
 - High-power-density racks, more than 60 kW per rack.
- Holistic approach—integrate racks into the data center, the data center into the facility, and the facility into NREL's campus
- Capture and use data center waste heat: office and lab space (now) and export to campus (future).



Two key design parameters:

- IT cooling supply: 24°C (75°F) on hottest day of year, ASHRAE "W2" class
- IT return water: required 35°C (95°F) to heat facility on coldest day of the year.

Power Usage Effectiveness Metric




- PUE is the ratio of the total amount of power used by a computer data center facility to the power delivered to the computing equipment:

$$PUE = \frac{\mathbf{Lights\&Plugs + Cooling + Pumps + HVAC + IT Equipment}}{\mathbf{IT Equipment}}$$

- PUE values cover a wide range for data centers, with an overall average of approximately 1.8.
 - Data centers focusing on efficiency are achieving PUE values of 1.2 or less.
 - NREL's HPC Data Center achieved an annualized PUE rating of 1.04 in 2016.


Waste Heat (Energy) Reuse

- Heat energy in the energy recovery water (ERW) loop is available to heat the ESIF's process hot water (PHW) loop through the use of heat exchangers.
- Once heated, the PHW loop supplies:
 - Active chilled beams to heat office space
 - Air handling units to heat the conference and high-bay spaces
 - Snowmelt loop in the courtyard approaching the ESIF's main entrance
 - District heating loop.

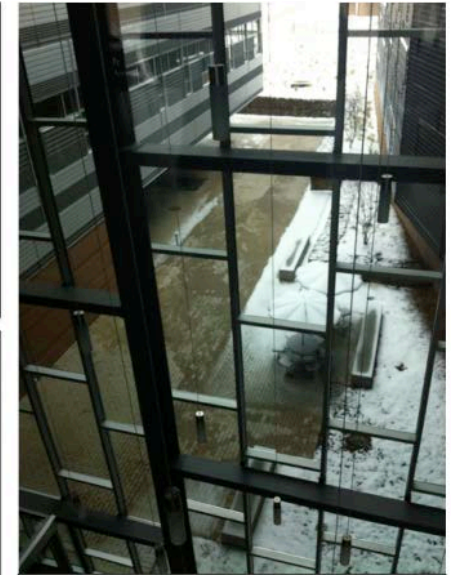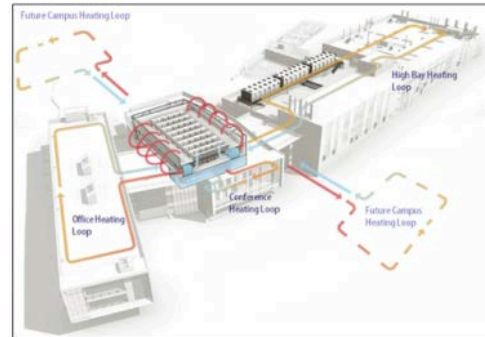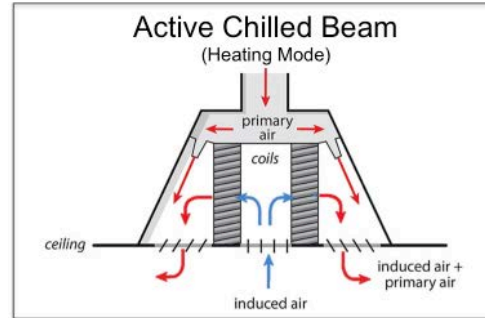


Snow melt in ESIF courtyard

System Schematic: Original Configuration

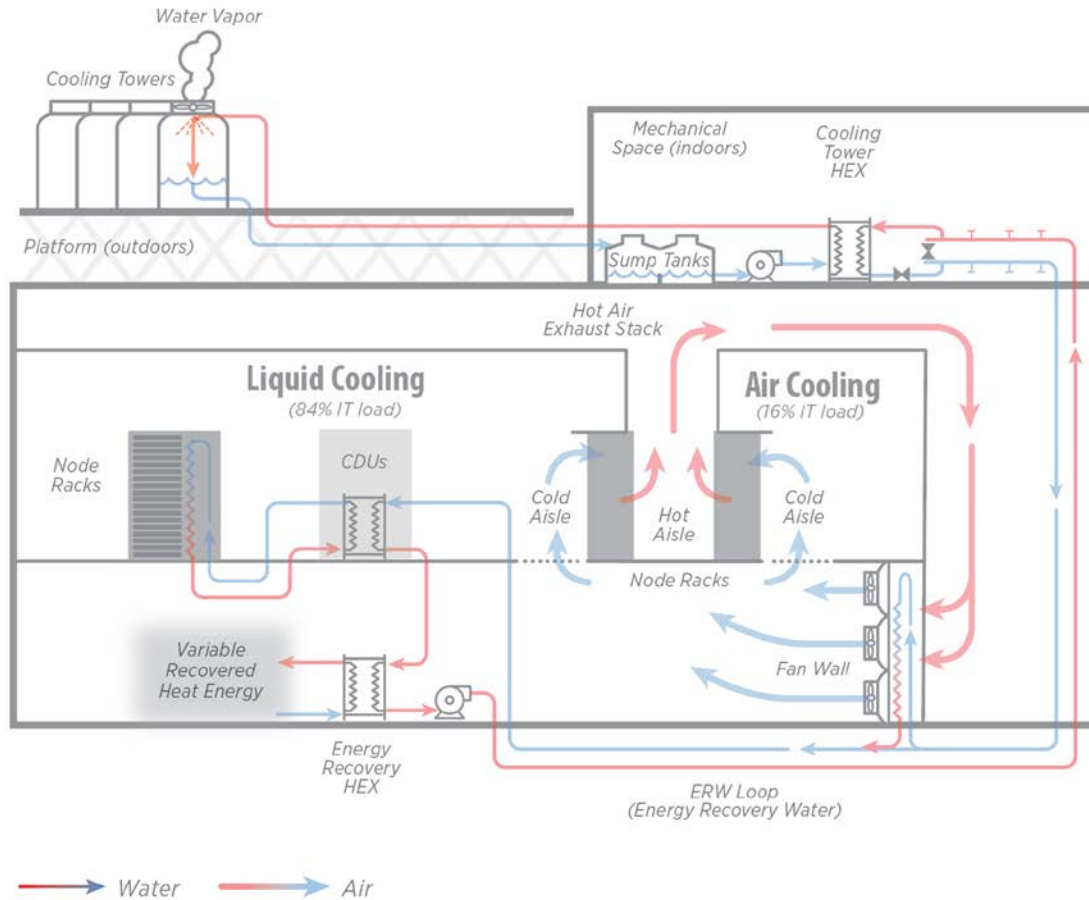


PUE ≤ 1.06

System Schematic: Current Configuration

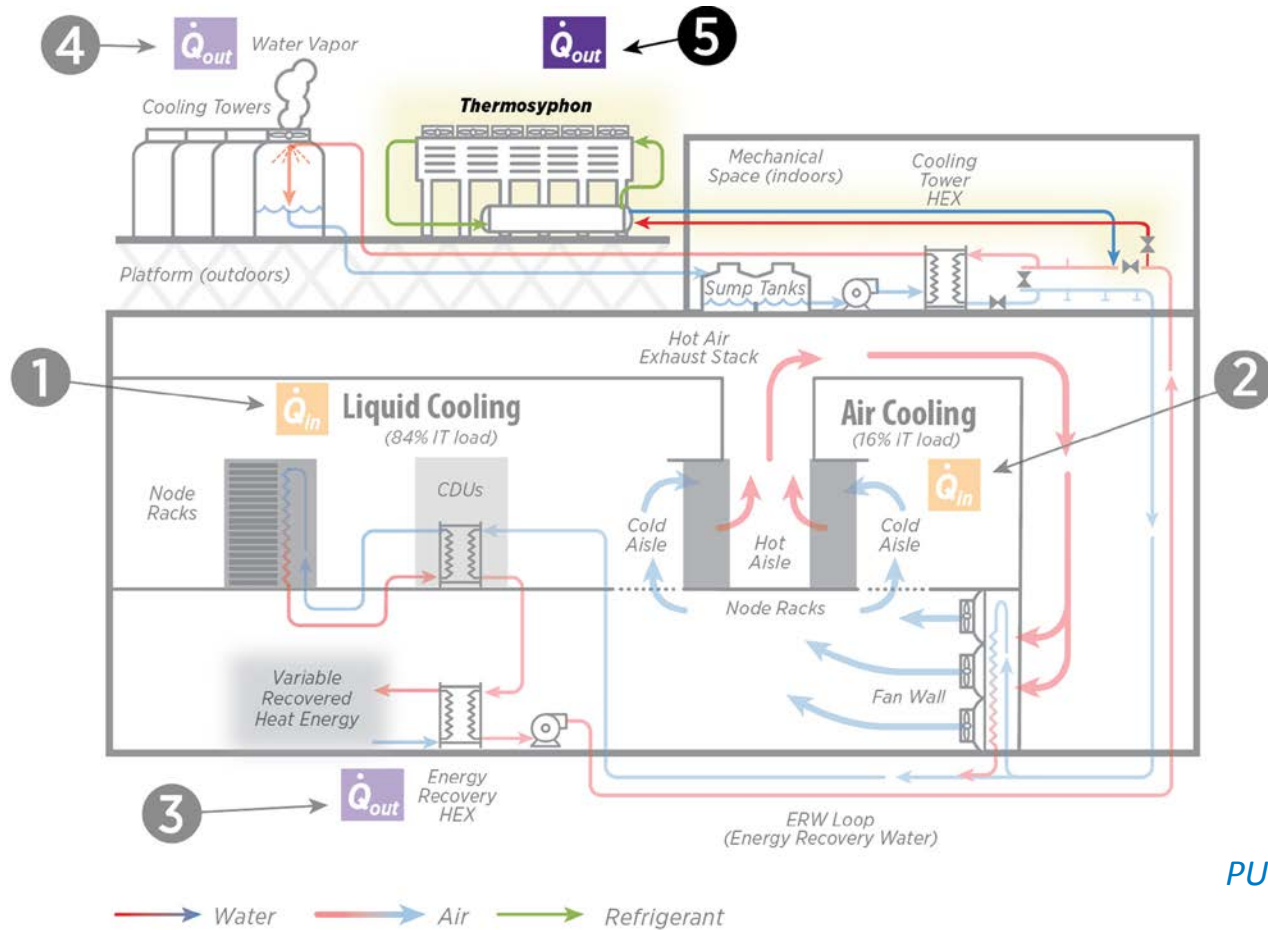

PUE \leq 1.06 (still)

System Modification

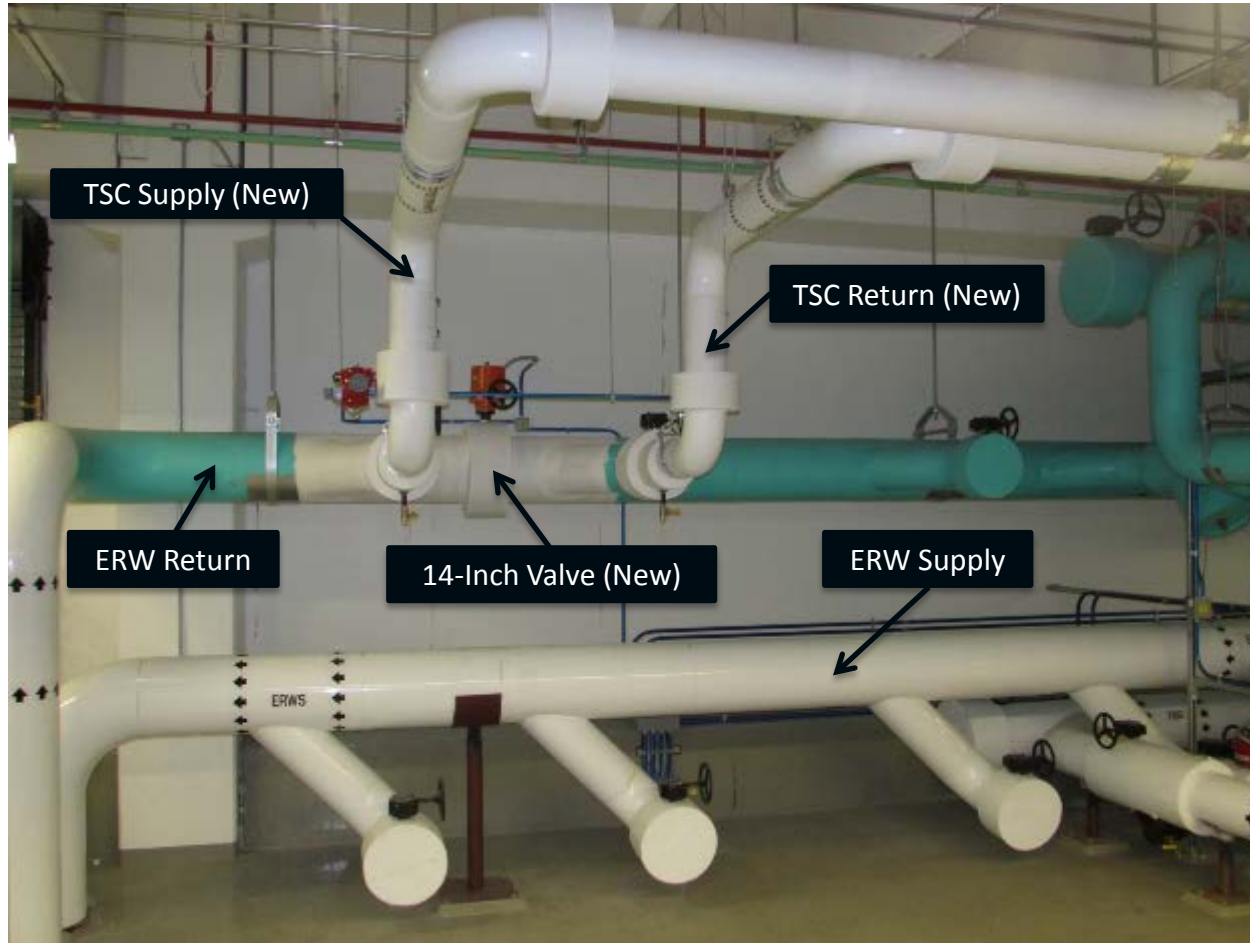

Thermosyphon Cooler Installation

TSC (New)

Three Towers for
Lab/Office Space

Four Towers for
HPC Data Center

Photo by Dennis Schroeder, NREL 42001



System Modeling Program

Golden, CO

Row = 2331

WB = 46.4
DB = 57.2
Atms = 23.907



Monday
April 7
10AM to 11AM


Plot Interval

- Yearly
- Monthly
- Weekly
- Daily

Twr Speed = 11.5% Twr Fan kW = 0.09
Twr ACFM = 30,050 Twr Load = 0.3354
Twr Lvg WB = 62.4 % HR Load = 36.9%
Twr Lvg DB = 64.7
TSC Speed = 54.0% TSC Fan kW = 3.45
TSC ACFM = 82,277 TSC Load = 0.3994
TSC Lvg WB = 53.7 % HR Load = 43.9%



(Note: All Loads are in MW's, All Temperatures are in °F)

Version: C9

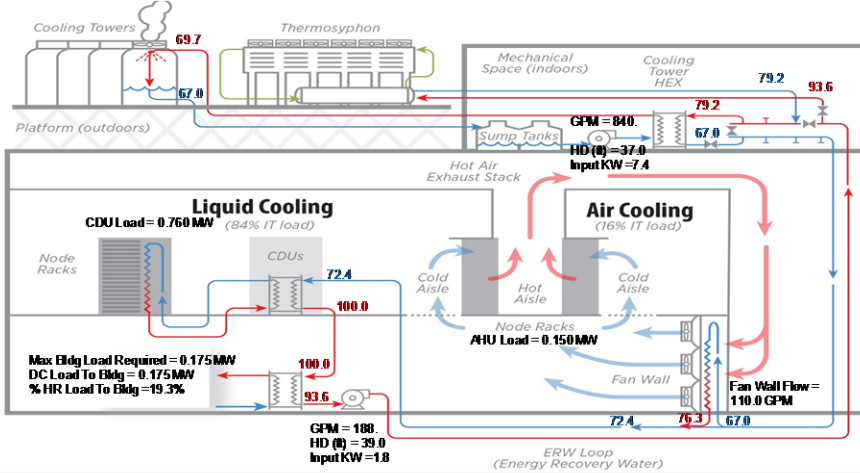

	Hourly	Annual
Total DC Load	0.910	7,972
Load to Atmos	0.735	5,748
Bldg Heat Required	0.175	3,461
Load to Bldg Heat	0.175	2,232.2
Load to Aux CWS	0.000	0
Electrical Energy (kWh)	12.7	77,293
Water Usage (Gal)	132.0	978,089
HR System PUE	1.014	1.010
WUE (L/kWh)	0.549	0.464
ERF	0.077	0.112


Energy = \$0.07/kWh
Water = \$6.08/kgal

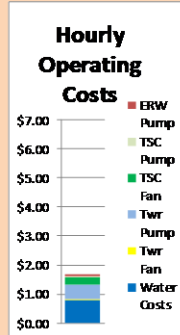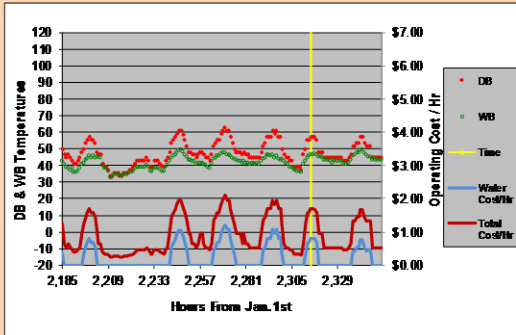

Hourly Costs	%
ERW Pump	\$0.094 6%
TSC Pump	\$0.029 2%
TSC Fan	\$0.241 14%
Twr Pump	\$0.518 31%
Twr Fan	\$0.006 0%
Water Costs	\$0.803 47%
Total	\$1.69 100%

Annual Costs	%
Elect. Costs	\$5,411 48%
Water Costs	\$5,950 52%
Total Costs	\$11,361 100%

Heat Rejection By Device




Favorable Application Characteristics

Any application using an open cooling tower is a potential application for a hybrid cooling system, but certain characteristics will increase the potential for success.

Favorable application characteristics:


- Year-round heat rejection load (24/7, 365 days is best)
- Higher loop temperatures relative to average ambient temperatures
- High water and wastewater rates or actual water restrictions
- Owner's desire to mitigate risk of future lack of continuous water availability (water resiliency)
- Owner's desire to reduce water footprint to meet water conservation targets.

Modeling Results: Makeup GPM vs. Dry Bulb Temperature

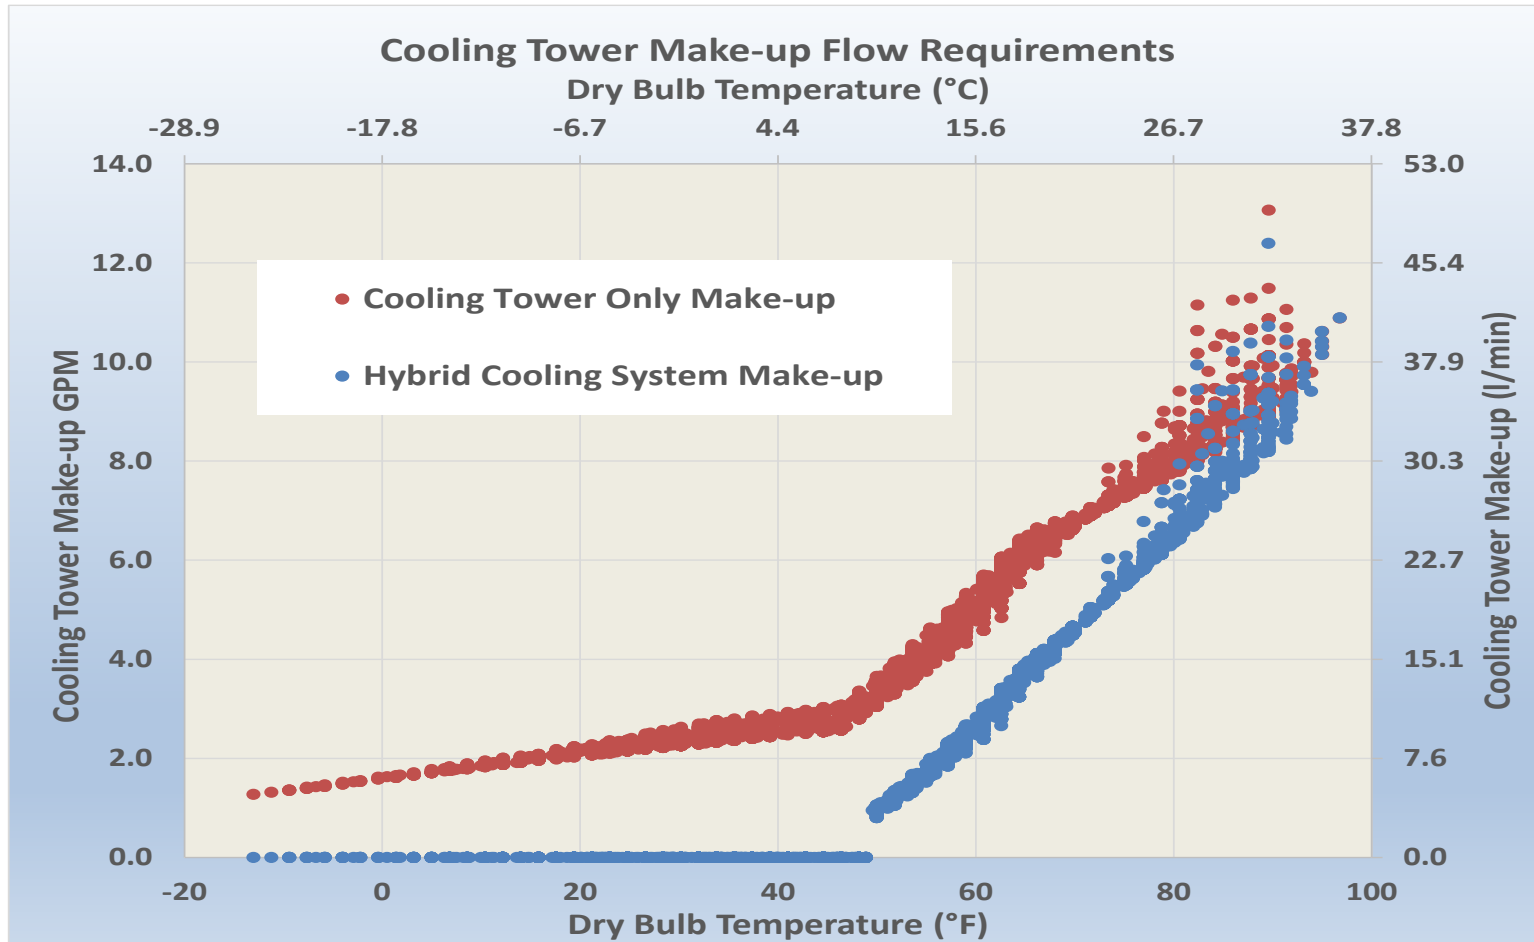

Modeling Results: Overall Water Use

Annual Cooling Tower Make-up Volume

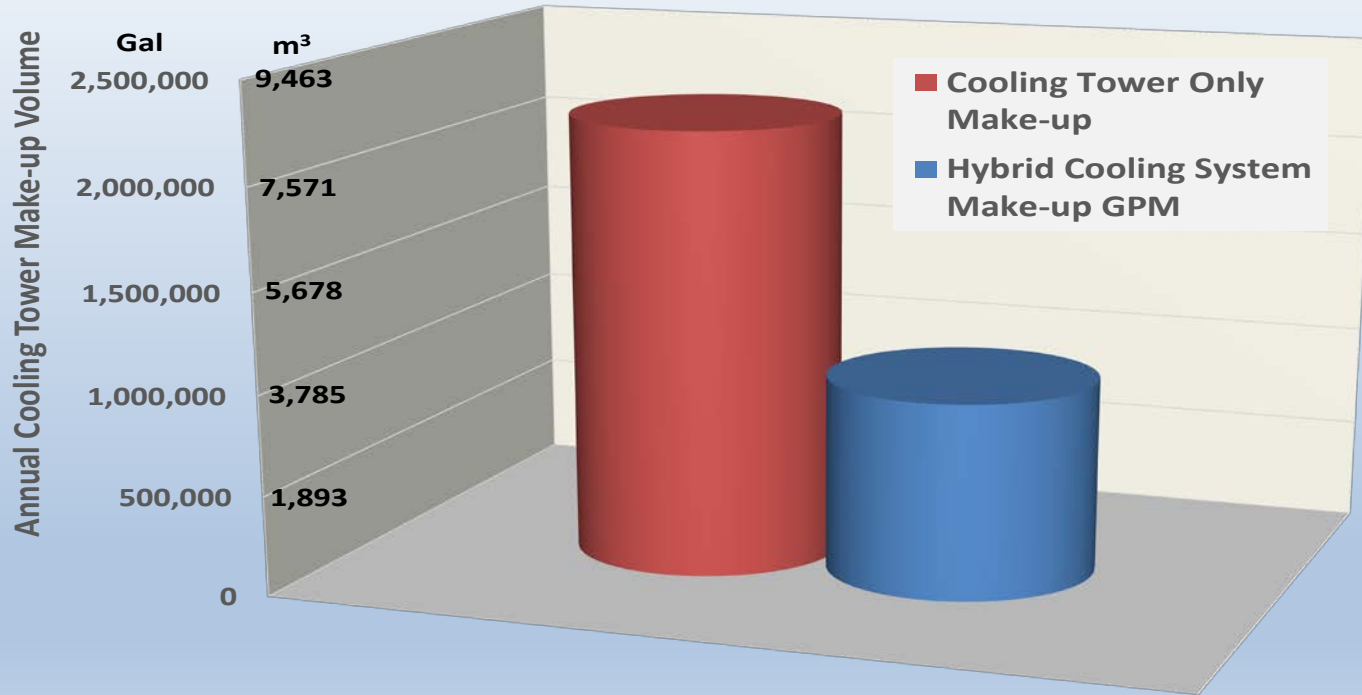


Controls Allow for Saving Both Water and Operational Costs

WECER = Water-to-Energy Cost Equivalence Ratio:



- **WECER = cost of water/cost of electricity**
- **WECER = (\$/1,000 gal water) / (\$/kWh)**
- **WECER = kWh/1,000 gal.**

TSC fan speed = f (WECER and (entering water-DB)).

Modeling Results: Operational Cost

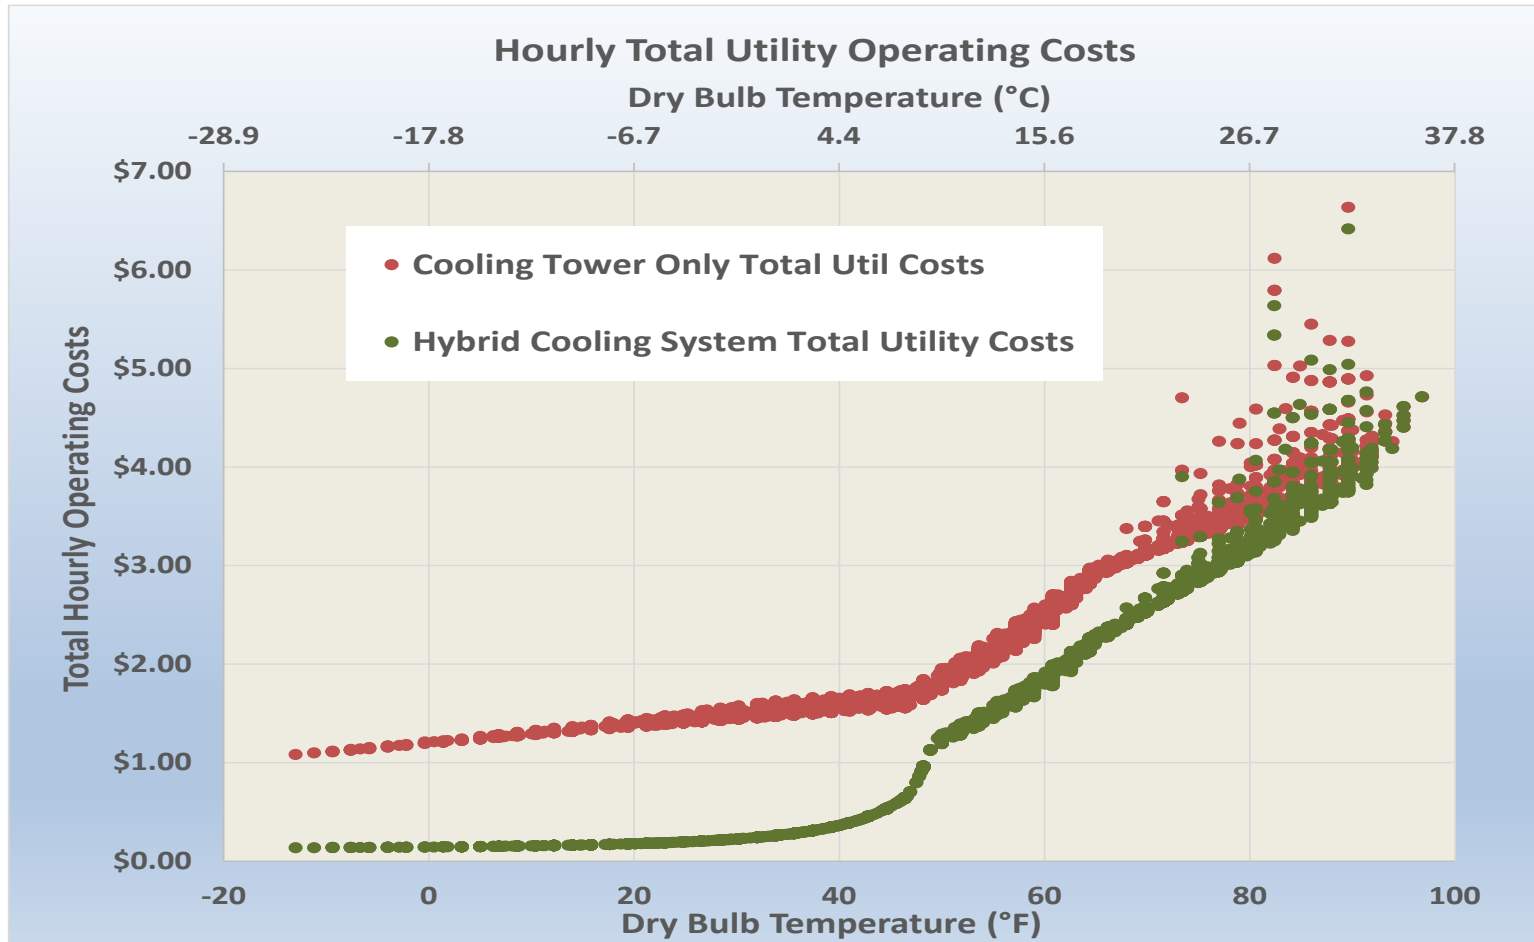

Sample Data: Typical Loads and Heat Sinks

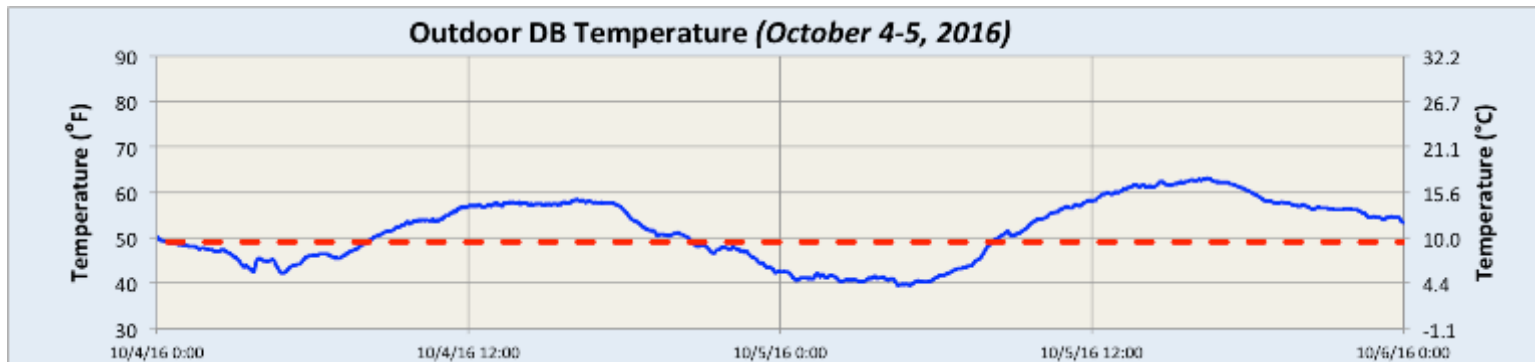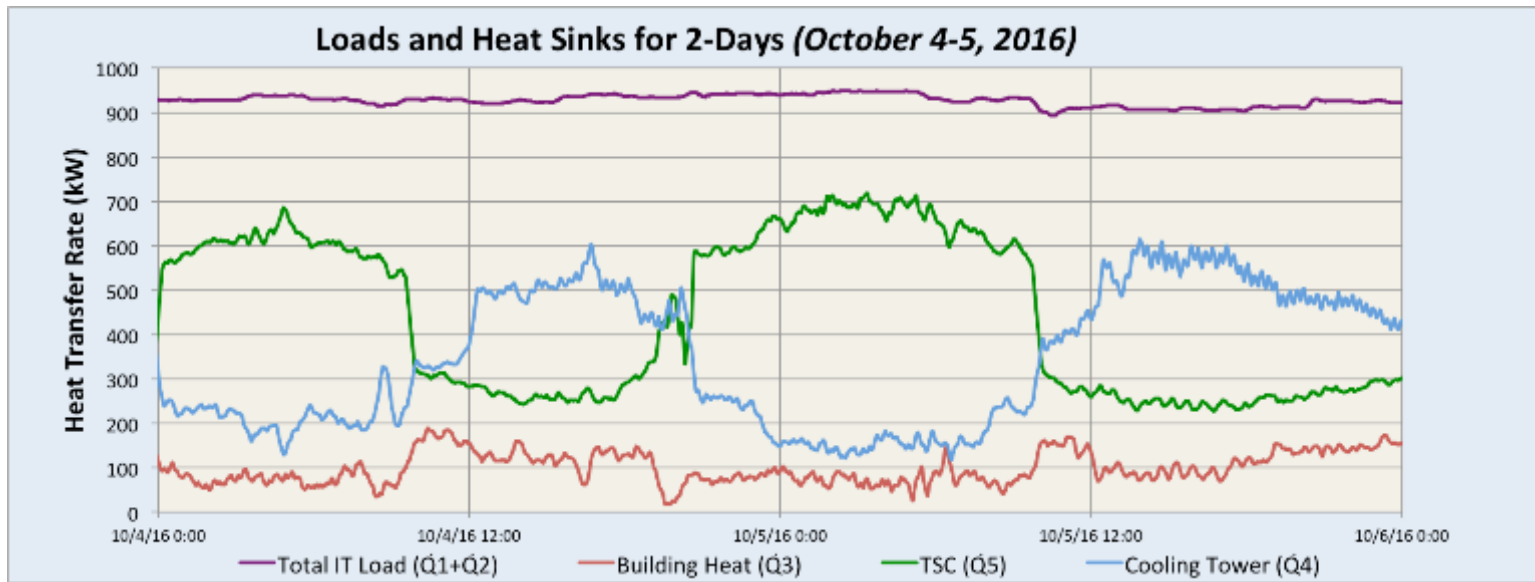

Early Data: Cumulative Water and Cost Savings

Cumulative Estimated TSC Operational Cost & Water Savings At The NREL ESIF Installation



Conclusions

- Warm-water liquid cooling has proven very energy efficient in operation.
- Initial modeling of a hybrid system showed that it was possible to save significant amounts of water while simultaneously reducing total operating costs.
- System modification was straightforward.
- Initial data indicate that the system water and operational cost savings are in line with modeling.

Bibliography

Carter, T.; Liu, Z.; Sickinger, D.; Regimbal, K.; Martinez, D. 2017. Thermosyphon Cooler Hybrid System for Water Savings in an Energy-Efficient HPC Data Center: Modeling and Installation. (LV-17-C005) Presented at the ASHRAE Winter Conference, Las Vegas, NV, January 28 – February 1, 2017.

Additional resources:

- <https://hpc.nrel.gov/datacenter>
- www.JohnsonControls.com/BlueStream.

Thank you!

Tom Carter

Thomas.P.Carter@jci.com

David Sickinger

David.Sickinger@nrel.gov



Visit us at Booth 67.

